

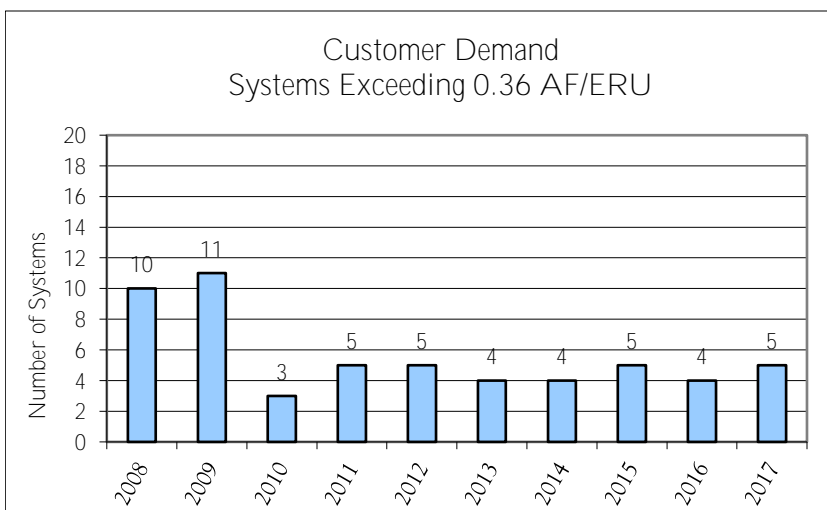


2017 WATER USE EFFICIENCY (WUE) GOALS GROUP A COMPANYWIDE PROGRESS REPORT

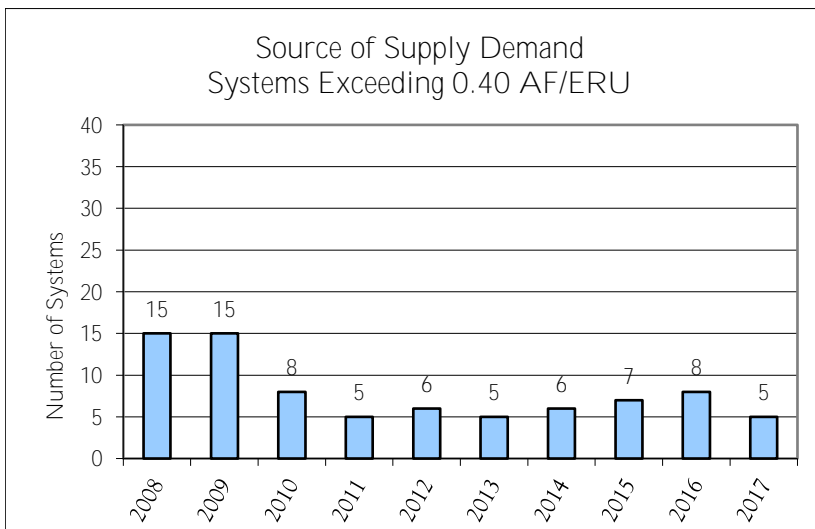

Total Number of Systems
Washington Water Owns and
Manages
196 Group A & B, Owned and Managed

Systems Evaluated for WUE
102 Group A Owned

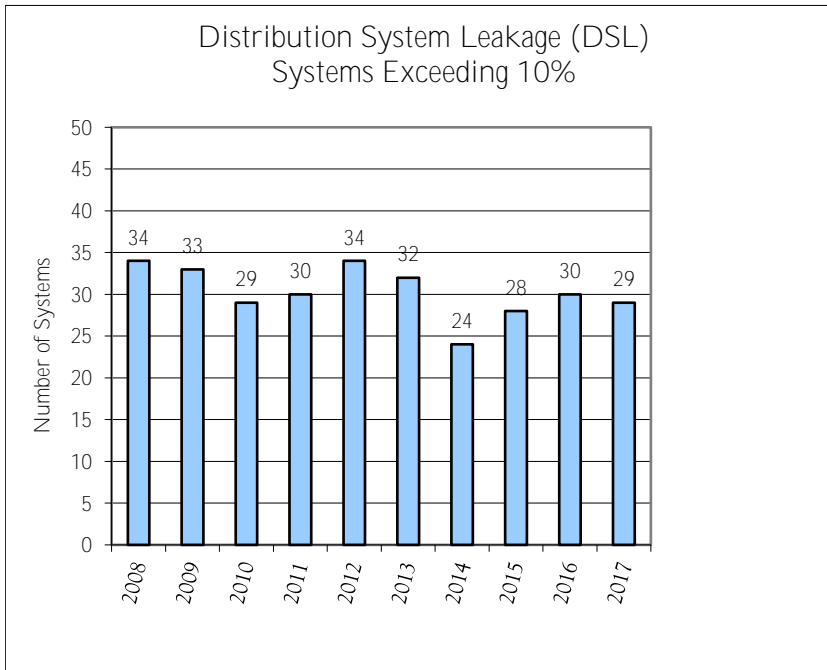

Goal Achievement Priorities

- First Prioritize and fix systems with DSL over 10%

- Second Prioritize and fix systems with Source of Supply Demand in excess of 0.40 AF/ERU

- Third Prioritize and fix systems with Customer Demand in excess of 0.36 AF/ERU

Lastly After companywide goals have been achieved, set system specific WUE goals.

Definitions

All Group A Systems with 15 or more connections

- AF Acre-Feet
- ERU Typical residential connection

